



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**NOTICE OF ACCEPTANCE (NOA)**

**Volatile Free, Inc.**  
**P.O. Box 344**  
**Brookefield, WI 53008**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code and the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Volatile Free Inc. Foam and Coating System over Steel Deck**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 4.  
The submitted documentation was reviewed by Jorge L. Acebo



NOA No.: 07-1120.08  
Expiration Date: 02/28/13  
Approval Date: 02/28/08  
Page 1 of 4

**ROOFING COMPONENT APPROVAL**

**Category:** Roofing  
**Sub-Category:** Spray Applied Polyurethane Roof System  
**Materials:** Polyurethane  
**Deck Type:** Steel  
**Maximum Design Pressure:** -340 psf

**TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:**

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
VFI 730	N/A	TAS 110	Polyurethane spray applied foam that utilizes an HFC blowing agent intended for roofing applications.
VFI 540 FR		TAS 143	A two component high performance industrial Urethane/Polyurea fluid applied membrane for application over spray polyurethane foam roof systems.
VFI-11 Primer	N/A	proprietary	A two component, water based epoxy general purpose primer for spray applied polyurethane foam to various substrates.
VFI-1003 Primer	N/A	proprietary	Single component polyurethane containing micaceous iron oxide general purpose primer for spray applied polyurethane foam to various substrates.
VFI-1007	N/A	proprietary	A moisture cure, single component polyurethane primer general purpose primer for spray applied polyurethane foam to various substrates.

**TRADE NAMES OF PRODUCTS MANUFACTURED BY OTHERS:**

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>	<u>Manufacturer</u>
Any Miami-Dade County Approved Roof Coating	N/A	As Required by Miami-Dade County PCA	Roof coating for application over polyurethane spray applied foam.	Generic. (with current PCA)

**EVIDENCE SUBMITTED:**

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
PRI Construction Materials Technologies	VFI-003-02-01	TAS 110	11/05/07
		TAS 114-D	
Underwriters Laboratories	IRT-012-02-01	TAS 143	09/23/02
	TGFU.R19184	UL 790	11/08/07



NOA No.: 07-1120.08  
 Expiration Date: 02/28/13  
 Approval Date: 02/28/08  
 Page 2 of 4

**APPROVED ASSEMBLIES:**

- Deck Type 2:** Steel
- Deck Description:** 18 to 22 gage galvanized steel
- System Type:** Sprayed polyurethane foam covered with an Approved Miami-Dade County roof coating.

**All General and System Limitations apply.**

**Surface**

**Preparation:** Metal surfaces, if needed, should be primed according to Volatile Free, Inc. and coating manufacturers' recommendations. Primer shall be thoroughly dried prior to application of foam.

For ferrous metal, remove loose rust and unsound primer from shop-primed iron and steel surfaces by scraping, wire brushing or sandblasting. Prime according to Volatile Free, Inc. and coating manufacturer's recommendations. For non-ferrous metals, clean and prime aluminum, copper and stainless steel surfaces as recommended by Volatile Free, Inc.

Primers shall be applied in accordance with their manufacturer's instructions. All primers must be thoroughly dried prior to foam application.

**Polyurethane Foam Application:**

The polyurethane foam shall be applied uniformly over the entire surface at a minimum thickness of 1" in compliance with the requirements set forth Roofing Application Standard RAS 109. The sprayed polyurethane foam shall be feathered at the edges to produce a smooth transition.

**Protective Coating Application:**

Shall apply a Miami-Dade County approved roof coating with a current NOA applied in accordance with the guidelines listed in the NOA.


Polyurethane foam surface shall be free of moisture, dust, debris, oils, tars, grease or other materials that will impair adhesion of the protective coverings. Any damage or defects to the polyurethane foam surface shall be repaired prior to the coating application. The coating shall be applied the same day as the foam when possible. If more than 72 hours elapse prior to the application of the coatings, the polyurethane foam shall be inspected for UV degradation.

**Maximum Design Pressure:**

-340 psf.



**TABLE 1  
 AMBIENT HUMIDITY APPLICATION LIMITS  
 SPRAYED POLYURETHANE FOAM**

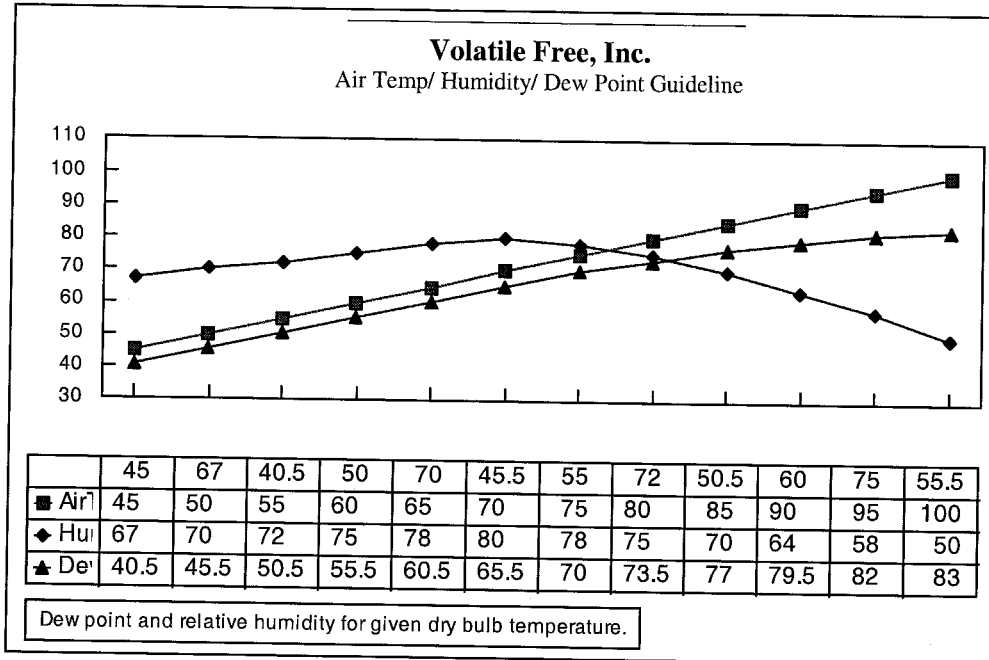

**GENERAL LIMITATIONS:**

1. Fire classification is not part of this acceptance, refer to a current Approved Roofing Materials Directory for fire ratings of this product
2. Spray polyurethane foam shall not be sprayed when ambient temperature is within 5 degrees of the dew point. Ambient humidity applications limits shall be as listed in Table 1 herein. Contractor shall monitor and record environmental conditions in the Job Log in compliance with RAS 109. Job Log shall be maintained at the job site and accessible to The Building Official.
3. Flashings and waterproof coverings for expansion joints shall be of compatible materials and in accordance with Volatile Free, Inc. published literature.
4. Miscellaneous materials such as adhesives, elastomeric caulking compounds, metal, vents and drains shall be a composite part of the roof system and shall be compatible with the foam and coating.
5. All attachment and sizing of perimeter nailers, metal profile, and/or flashing termination designs shall conform to Roofing Application Standard RAS 111 and the wind load requirements of applicable building code.
6. The maximum designed pressure limitation listed shall be applicable to all roof pressure zones (i.e. field, perimeters, and corners). Neither rational analysis, nor extrapolation shall be permitted for enhanced fastening at enhanced pressure zones (i.e. perimeters, extended corners and corners).

**END OF THIS ACCEPTANCE**



NOA No.: 07-1120.08  
 Expiration Date: 02/28/13  
 Approval Date: 02/28/08  
 Page 4 of 4