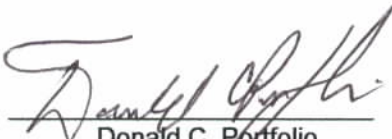



Results of Testing:

Physical Property	Test Method	Result	TAS 110-2000 Requirement
Compressive Strength, psi	ASTM D 1621	28.9	18 min
Water Absorption (73.4° ± 3.6°F for 96h @ 2 in. head), %	ASTM D 2842	0.6	1.0 max
Dimensional Stability @ 160°F and 97% RH for 28 days, %	ASTM D 2126	4.1	15 max
Water Vapor Permeability @ 74°F, perm in.	ASTM C 355	0.98	2.5 max
Tensile Strength, psi	ASTM D 1623	68.0	60 min
Shear Strength, psi	ASTM D 273	42.3	35 min
Closed Cell Content, %	ASTM D 2856	90.0	90 min
Uplift Resistance, psf	TAS 114	>-75	-45 min.

This product complies with the reported requirements of Florida Building Code (HVHZ) Testing Application Standard (TAS) 110-2000: *TESTING REQUIREMENTS FOR PHYSICAL PROPERTIES OF ROOF MEMBRANES, INSULATION, COATINGS, AND OTHER ROOFING COMPONENTS*: Section 6.0: Spray-Applied Polyurethane Foam Roof Assemblies: Physical Properties with the exception of uplift resistance which was not tested.

Signed: 
 Donald C. Portfolio
 President

Signed: 
 Duc T. Nguyen
 Florida Registered Professional Engineer
 P. E. Number: 65034

Date: 7/18/07

Date: 7/18/2007

VFI-003-02-01 PRI Accreditations: IAS-ES TL-189; State of Florida TST 5878; Metro-Dade 06-1116.02; CRRC

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. This report shall not be reproduced except in full without the written approval of this laboratory. PRI Construction Materials Technologies, LLC. assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report.